

Iron Reduction Method

Method 8140

3 to 450 µg/L DEHA; 5 to 600 µg/L carbohydrazide; 9 to 1000 µg/L hydroquinone; 13 to 1500 µg/L iso-ascorbic acid (ISA); 15 to 1000 µg/L methylethyl ketoxime (MEKO)

Powder Pillows

Scope and application: For testing residual corrosion inhibitors (oxygen scavengers) in boiler feed water or condensate




Test preparation

Instrument specific information

The table in this section shows all of the instruments that have the program for this test. [Table 1](#) shows sample cell and orientation requirements for reagent addition tests, such as powder pillow or bulk reagent tests.

To use the table, select an instrument, then read across to find the corresponding information for this test.

Table 1 Instrument-specific information for powder pillows

Instrument	Sample cell orientation	Sample cell
DR 6000 DR 3800 DR 2800 DR 2700	The fill line is to the right.	2495402 
DR 5000 DR 3900	The fill line is toward the user.	
DR 900	The orientation mark is toward the user.	2401906 

Before starting

Samples must be analyzed immediately after collection and cannot be preserved for later analysis.

Install the instrument cap on the DR 900 cell holder before ZERO or READ is pushed.

The sample temperature should be 25 ± 3 °C (77 ± 5 °F).

Clean all glassware with 6.0 N (50%) hydrochloric acid, then rinse thoroughly with deionized water to remove iron contaminants.

To measure the ferrous iron concentration, repeat the test procedure but do not add the DEHA Reagent 2. To automatically subtract the ferrous iron concentration from the test results, use the reagent blank adjust option. Use the ferrous iron concentration as the reagent blank value.

Review the Safety Data Sheets (MSDS/SDS) for the chemicals that are used and use any recommended personal protective equipment.

Dispose of reacted solutions according to local, state and federal regulations. Use the Safety Data Sheets for disposal information for unused reagents. Consult the environmental, health and safety staff for your facility and/or local regulatory agencies for further disposal information.

Items to collect


Description	Quantity
Bottle, glass mixing, with 25-mL mark	2
DEHA Reagent 1 Powder Pillows	2
DEHA Reagent 2 Solution	1 mL
Dropper, 0.5 and 1.0 mL marks	1
Hydrochloric acid, 1:1, 6.0 N	varies
Water, deionized	25 mL
Sample cells (For information about sample cells, adapters or light shields, refer to Instrument specific information on page 1.)	2

Refer to [Consumables and replacement items](#) on page 4 for reorder information.

Sample collection


- Samples must be analyzed immediately after collection and cannot be preserved for later analysis.
- Collect samples in clean, dry glass or plastic bottles with tight-fitting caps.
- Rinse the container several times with the sample before collection.
- Prevent agitation of the sample or exposure to sunlight or air.
- Fill the bottle completely and let the sample overflow. Immediately tighten the cap so that there is no headspace above the sample.

Powder pillow procedure

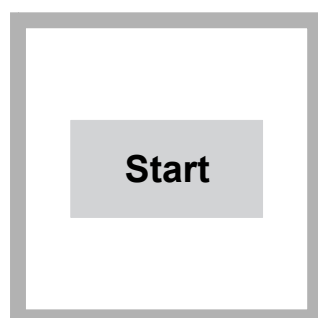


1. Start program 180 O Scav-Carbohy, 181 O Scav-DEHA, 182 O Scav-Hydro, 183 O Scav-ISA or 184 O Scav-MEKO. For information about sample cells, adapters or light shields, refer to [Instrument specific information](#) on page 1.


Note: Although the program name may vary between instruments, the program number does not change.

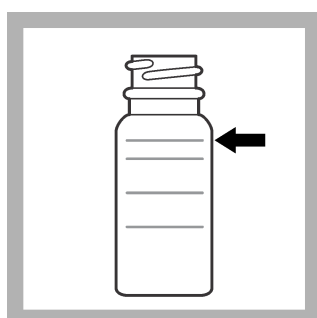


2. Prepare the blank: Fill a mixing bottle with 25 mL of deionized water.

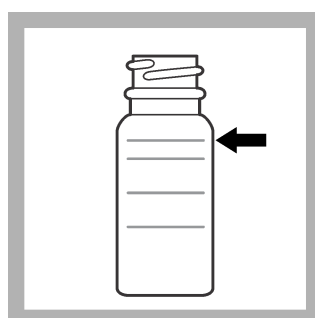

3. Prepare the sample: Fill a second mixing bottle with 25 mL of sample. To measure oxygen scavengers that react quickly with oxygen at room temperature, close the bottle.

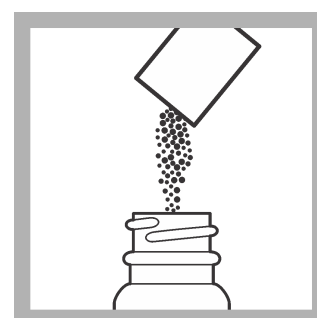


4. Add the contents of one DEHA Reagent 1 Powder Pillow to each mixing bottle.

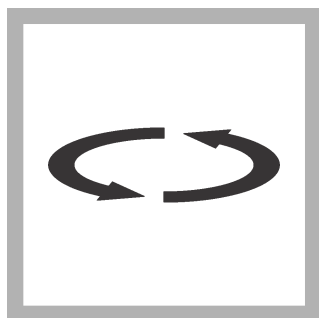

5. Swirl to mix.




6. Use a pipet to add 0.5 mL of DEHA Reagent 2 Solution to each bottle.

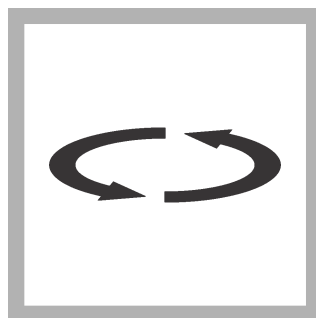


7. Swirl to mix. Put both mixing bottles in a dark location. A purple color shows if an oxygen scavenger is present in the sample.




8. Start the instrument timer. A 10-minute (2-minute for hydroquinone) reaction time starts. Keep the mixing bottles in the dark during the reaction period.

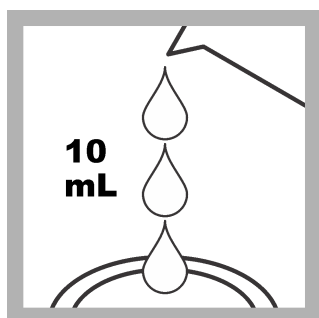


9. When the timer expires, transfer the blank and prepared samples to the sample cells.

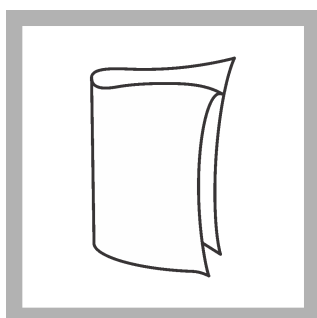


10. Clean the blank.

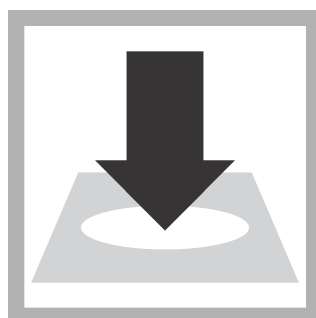


11. Insert the blank into the cell holder.

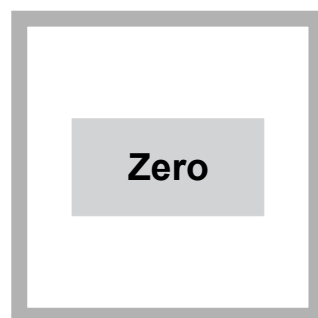


12. Push **ZERO**. For greater accuracy, read the result immediately after the timer expires.

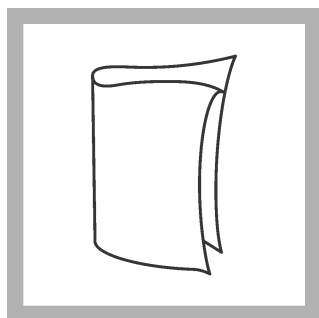

13. Clean the prepared sample.

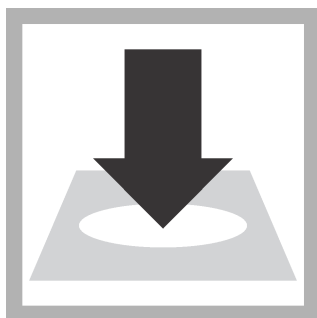

14. Insert the prepared sample into the cell holder.

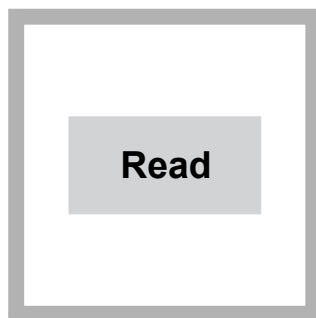

15. Push **READ**. Results show in µg/L.

Interferences

Substances which reduce ferric iron will interfere. Substances which complex iron strongly may also interfere.

Interfering substance	Interference level
Borate (as $\text{Na}_2\text{B}_4\text{O}_7$)	More than 500 mg/L
Cobalt	More than 0.025 mg/L
Copper	More than 8.0 mg/L
Ferrous Iron	All levels. Measure and subtract (refer to Before starting on page 1)

Interfering substance	Interference level
Hardness (as CaCO ₃)	More than 1000 mg/L
Light	Light may interfere. Keep sample cells in the dark during color development.
Lignosulfonates	More than 0.05 mg/L
Manganese	More than 0.8 mg/L
Molybdenum	More than 80 mg/L
Nickel	More than 0.8 mg/L
Phosphate	More than 10 mg/L
Phosphonates	More than 10 mg/L
Sulfate	More than 1000 mg/L
Temperature	Sample temperatures below 22 °C or above 28 °C (72 °F or 82 °F) may affect test accuracy.
Zinc	More than 50 mg/L

Method performance

The method performance data that follows was derived from laboratory tests that were measured on a spectrophotometer during ideal test conditions. Users may get different results under different test conditions.

Program	Standard	Precision (95% Confidence Interval)	Sensitivity Concentration change per 0.010 Abs change
180	299 µg/L	295–303 µg/L	4 µg/L
181	226 µg/L	223–229 µg/L	3 µg/L
182	600 µg/L	591–609 µg/L	8 µg/L
183	886 µg/L	873–899 µg/L	12 µg/L
184	976 µg/L	962–990 µg/L	14 µg/L

Summary of method

Diethylhydroxylamine (DEHA) or other oxygen scavengers in the sample react with ferric iron in DEHA Reagent 2 Solution to produce ferrous ion in an amount that is equivalent to the DEHA concentration. This solution then reacts with DEHA 1 Reagent, which forms a purple color with ferrous iron that is proportional to the concentration of the oxygen scavenger. This method reacts with all oxygen scavengers and does not differentiate when the sample contains more than one type of oxygen scavenger. The measurement wavelength is 562 nm for spectrophotometers or 560 nm for colorimeters.

Consumables and replacement items

Required reagents

Description	Quantity/test	Unit	Item no.
Hydrochloric Acid, 6.0 N	varies	500 mL	88449
Water, deionized	varies	4 L	27256
Oxygen Scavenger Reagent Set	—	—	2446600
Includes:			
DEHA Reagent 1 Powder Pillows	2	100/pkg	2167969
DEHA Reagent 2 Solution	1 mL	100 mL	2168042

Required apparatus

Description	Quantity/test	Unit	Item no.
Bottle, square, with 25 mL mark	1	each	1704200
Dropper, measuring, 0.5 and 1.0 mL plastic	2	20/pkg	2124720
Sample cell, 10 mL square, matched pair	2	2/pkg	2495402

Optional apparatus

Description	Unit	Item no.
Thermometer, non-mercury, -10 to +225 °C	each	2635700



FOR TECHNICAL ASSISTANCE, PRICE INFORMATION AND ORDERING:

In the U.S.A. – Call toll-free 800-227-4224

Outside the U.S.A. – Contact the HACH office or distributor serving you.

On the Worldwide Web – www.hach.com; E-mail – techhelp@hach.com

HACH COMPANY

WORLD HEADQUARTERS

Telephone: (970) 669-3050

FAX: (970) 669-2932